



# Power Quality Enhancement of Grid-Connected Solar Photovoltaic System using ANN based Filter

P Hari Pallavi<sup>1</sup> | P Ankineedu Prasad<sup>2</sup>

<sup>1</sup>PG student in the Department of Electrical and Electronics Engineering, Vikas Group of Institutions, Vijayawada, Andhra Pradesh, India.

<sup>2</sup>Associate Professor in the Department of Electrical and Electronics Engineering, Vikas Group of Institutions, Vijayawada, Andhra Pradesh, India.

## To Cite this Article

P Hari Pallavi and P Ankineedu Prasad, "Power Quality Enhancement of Grid-Connected Solar Photovoltaic System using ANN based Filter", *International Journal for Modern Trends in Science and Technology*, Vol. 07, Issue 03, March 2021, pp.: 84-89.

## Article Info

Received on 06-February-2021, Revised on 28-February-2021, Accepted on 03-March-2021, Published on 11-March-2021.

## ABSTRACT

Grid-connected photovoltaic (PV) systems are increasingly attracting the attention of industry and academia as a means of providing an alternative to conventional fossil-fuel generation and pollution-free power. This project aims to improve the power quality level of a grid-tied PV distribution system using shunt active power filter (APF) along with adaptive current control technique.

In this work Artificial Neural Network controller used to destroy the voltage and current harmonics in a grid-tied PV system. A reference current generation strategy is implemented to mitigate the current harmonics by extracting the fundamental constituents (FCs) from the nonlinear load currents. MCCF is employed to separate the FC from the distorted grid voltages and eliminates the voltage harmonics during extremely polluted grid voltage condition. The comparative analysis is analyzed to check the effectiveness of the proposed hybrid control scheme with existing and adaptive control techniques in respect of power quality, better dc offset rejection, better FC and frequency extraction, and grid synchronization.

**KEY WORDS:-** Photovoltaic System, P & O MPPT, Boost Converter, LCL Filter, and Grid Connection.

## INTRODUCTION

At present, most of energy demand in the world relies on fossil fuels such as petroleum, coal, and natural gas that are being exhausted very fast. One of the major severe problems of global warming is one of these fuels combustion products, carbon dioxide; these are resulting in great danger for life on our planet [1].

Among all the available Renewable energy sources, PV array systems are trusted to play a significant role in prospective energy production. PV systems transform photon energy into electrical energy. These energy systems generate low voltage output, thus, high step-up dc/dc converters are

employed in many applications, including fuel cells, wind power, and photovoltaic systems, which converts low voltage into high voltage. Due to the increasing demand on electricity, and limited availability and high prices of non-renewable sources, the photovoltaic (PV) energy conversion system has becomes an alternative as it is freely available, pollution free, and has less operation al and low maintenance cost. Therefore, the utilization of PV energy systems has to be increased for standalone and as well as grid-connected modes of PV systems. Photovoltaic (PV) as a renewable energy resource naturally is not stable by location, time, season and weather

and its installation cost is comparatively high. An important consideration in increasing the efficiency of PV systems is to operate the system near maximum power point (MPP) so to obtain the approximately maximum power of PV array. For getting maximum possible energy produced by a solar system.

Also maximum power point tracking (MPPT) techniques are used for improving the performance of PV systems, a high efficiency power converter which is designed to extract maximum power from a PV panel is usually considered. Generally, there will be a unique point on the V -I curve, called the Maximum Power Point (MPP), at which the whole PV system serves with maximum efficiency and produces its maximum power output [15-17]. The position of the MPP is unknown, but can be placed either by search algorithms or through calculation models. Maximum Power Point Tracking Techniques (MPPT) are used to maintain the PV array's operating point at the precise position where maximum power can be delivered. Various MPPT algorithms have been considered in the literature; some of them are the Perturb and Observe (P&O) method [2-5], the Incremental Conductance (IC) method [2-6], the Artificial Neural Network method [7], the Fuzzy Logic method [8] etc .. The P&O and IC techniques, are the most widely used. In this paper, four MPPT algorithms are considered: P&O, Incremental Conductance (IC) method [2-6], Fuzzy Logic method [8], Particle Swarm Optimization method [10]. These methods are quite easily implemented and have been widely adopted for low cost applications. Other methods such as Sliding Mode [9], are not considered in this paper, because they are more complex and rarely used.

This paper focuses on developing a simulation model to design and size the hybrid system for a variety of loading and meteorological conditions. This simulation model is performed using Matlab and SimPower Systems and results are presented to verify the effectiveness of the proposed system. The proposed grid connected hybrid energy generation system is shown in figure 1.

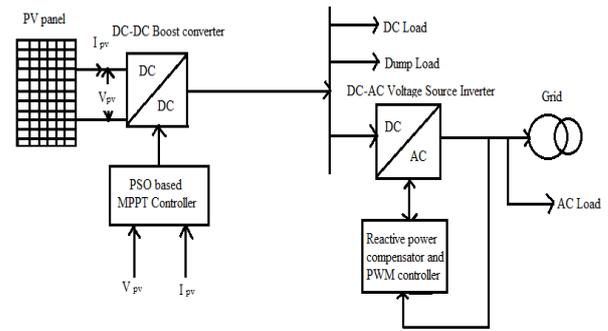


Figure 1: Configuration of proposed grid connected hybrid system

### Literature Survey:

Ciobotaru et al. [15] discussed the issue of control strategies for single-stage photovoltaic (PV) inverter is addressed. Two different current controllers have been implemented and an experimental comparison between them has been made. A complete control structure for the single-phase PV system is also presented. Mahmud et al. [16] presented a robust nonlinear distributed controller design for islanded operation of microgrids in order to maintain active and reactive power balance. In this paper, microgrids are considered as inverter-dominated networks integrated with renewable energy sources (RESs) and battery energy storage systems (BESSs), where solar photovoltaic generators act as RESs and plug-in hybrid electric vehicles as BESSs to supply power into the grid. Power electronics converters play an important role in realization and performance improvement of electrical power system. With the demand for new power resource and better power supply quality, more and more distributed energy resources (DERs) come into practice. A model predictive controller is designed to decrease common mode voltages and errors between the capacitor voltages and their reference values. Finally, simulation diagram, parameters and results using software PLECS are provided to demonstrate the merits of multilevel inverters and the validity of proposed control method by Bo and Yang [17].

### SOLAR SYSTEM

In photovoltaic (PV) system, solar cell is the basic component. PV array is nothing but solar cells are connected in series or parallel for gaining required current, voltage and high power. Each Solar cell is similar to a diode with a p-n junction formed by semiconductor material [5]. It produces the currents when light absorbed at the junction, by the photovoltaic effect. Figure 3 shows at an

insolation output power characteristic curves for the PV array. It can be seen that a maximum power point exists on each output power characteristic curve. The Figure 3 shows the (I-V) and (P-V) characteristics of the PV array at different solar intensities. The equivalent circuit of a solar cell is the current source in parallel with a diode of a forward bias. Load is connected at the output terminals. The current equation of the solar cell is given by:

$$I = I_{ph} - I_D - I_{sh}$$

$$I = I_{ph} - I_o [\exp (q V_D / nKT)] - (V_D / R_S)$$

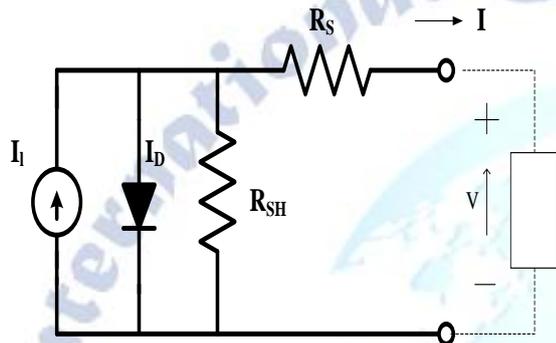


Figure 2: Equivalent circuit of PV Module

Power output of solar cell is  $P = V * I$

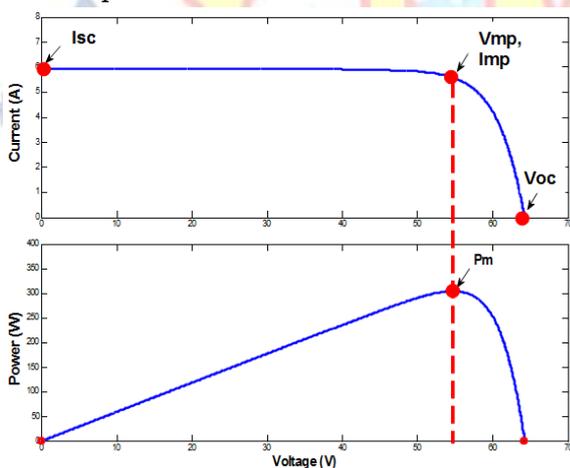


Figure 3: Output characteristics of PV Array

### MAXIMUM POWER POINT TRACKING METHOD:

The irradiance and temperature curves are the two most vital factors which influence the output power characteristics of the PV system. And these two are momentarily maintained by solar irradiation and temperature. As discussed, there will be blunt changes in the values of solar radiation during the day as shown in Figure 1. A typical solar panel converts only 30 to 40 percent of the incident solar irradiation into electrical energy. According to Maximum Power Transfer theorem, the power output of a circuit is maximum when the thevenin impedance of the circuit (source impedance) matches with the load impedance. In this way, Maximum power point tracking

technique is necessarily used to improve the efficiency of the solar panel.

As the solar panel voltage /current increases, the PWM generator increases its repetition rate thus resulting in increased output current. At the same time, additional voltage is applied to the inductor thus increasing its charge current. Where the initialization is based on voltage and power calculations that are based on current and voltage values acquired from sensors [9]. Once the actual power is calculated, then the next cycle of the measurement is compared to previous value to change the reference voltage  $V_{ref}$ .

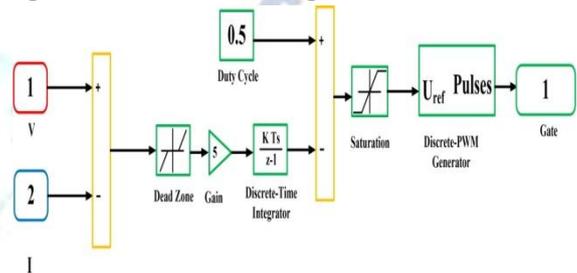


Figure 4: DC-DC converter MPPT Controller

### PROPOSED SYSTEM

The active power pumped by grid tied solar inverter into the grid is a function of solar insolation. This means that the amount of active power pumped into the grid will be lower than the designed rated capacity of solar inverter if the solar irradiance is less (which actually happens as the solar irradiance is not uniformly maximum throughout the day). This leads to underutilization of the inverter resource. If the inverter is programmed to provide reactive power also in addition to active power (based on solar irradiance availability) then the inverter can be operated at its rated capacity even when the solar resource is not fully available. Reactive power compensation through solar inverter is an interesting method to manage network voltages through reactive power injection and absorption.

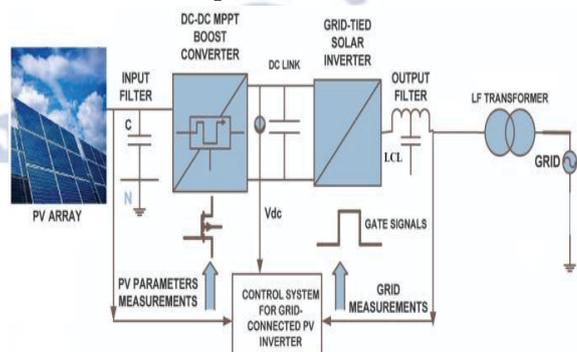


Figure 5: Structure of Grid Connected PV system for Reactive Power Control

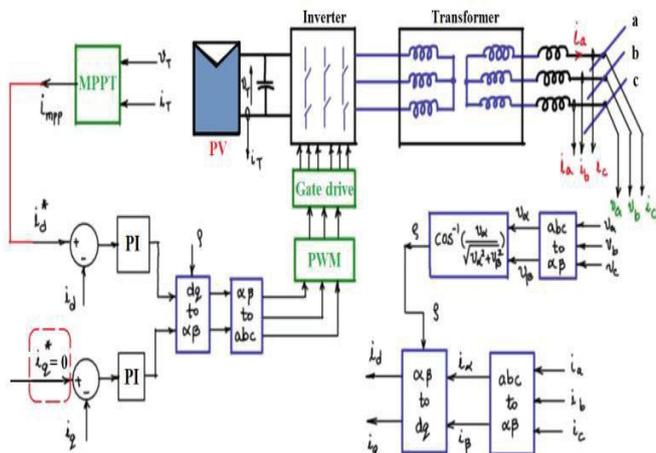


Figure 6: Control of VSI

### Artificial Neural Network:

Figure 7 shows the basic architecture of artificial neural network, in which an hidden layer is indicated by circle, an adaptive node is represented by square. In this structure hidden layers are presented in between input and output layer, these nodes are functioning as membership functions and the rules obtained based on the if-then statements is eliminated. For simplicity, we considering the examined ANN [14] have two inputs and one output. In this network, each neuron and each element of the input vector  $p$  are connected with weight matrix  $W$ .

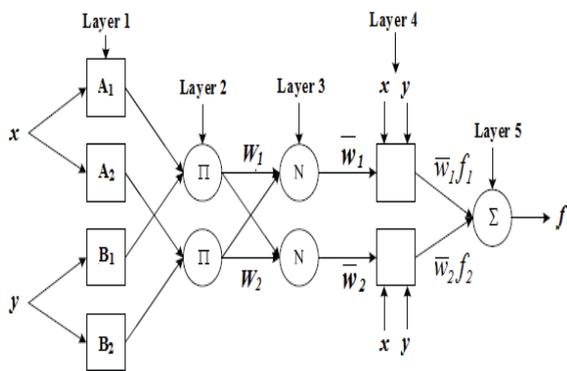


Figure 7: ANN architecture for a two-input multi-layer network

### RESULTS AND DISCUSSION:

The model of the proposed control scenario is developed on MATLAB/Simulink platform. The proposed system is implemented on several conditions, such as steady state, dynamic load, load removed, grid voltage unbalanced, variable solar irradiation level, and distorted grid voltage condition

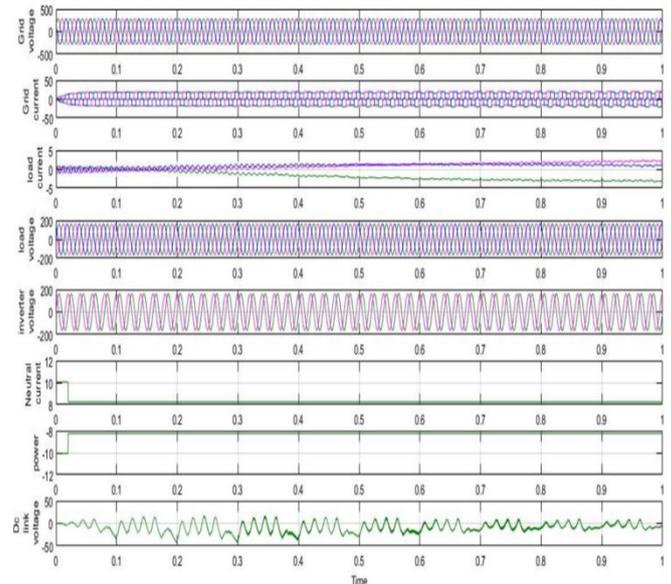


Figure 8: Simulation characteristics under polluted grid voltage condition

Figure 8 shows that the system is running under balanced supply voltage, load removed, and dynamic load conditions. From 0 to 0.08 s shows the grid balanced supply voltage condition. To examining the controller dynamic performance, phase "a" load is removed, which is shown in Figure 5.6 from 0.08 to 0.15 s. During 0.15–0.2 s, the proposed system is working under dynamic load condition.

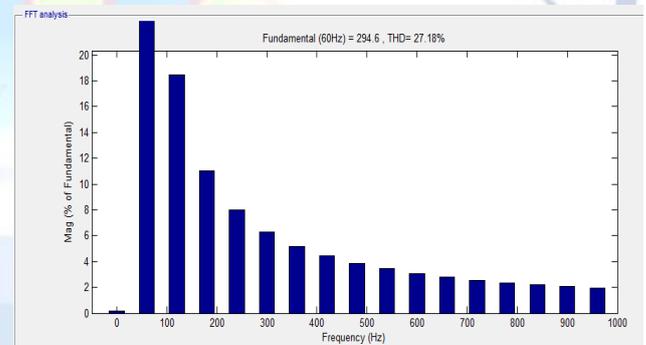


Figure 9: THD Source Voltage

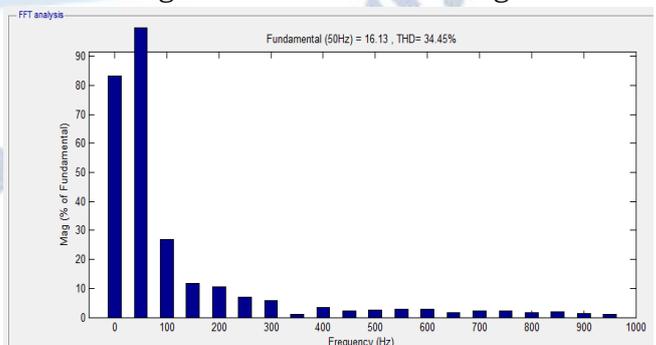


Figure 10: THD for Compensated voltage

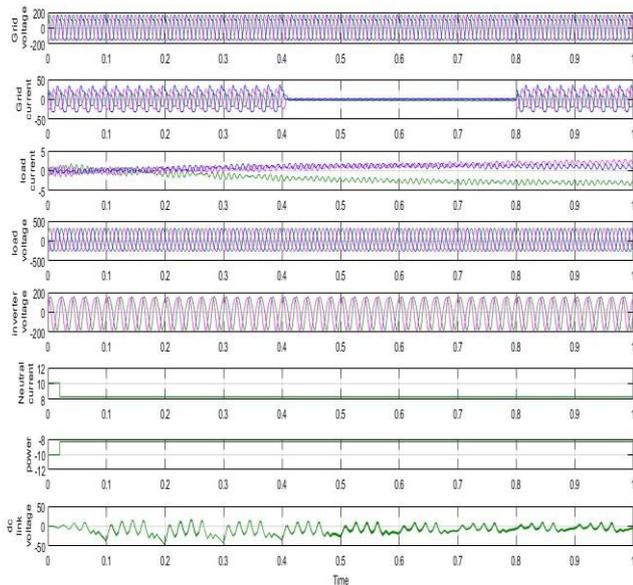


Figure 11: Simulation Results under Steady State, Load Removed, And Dynamic Load Conditions with ANN

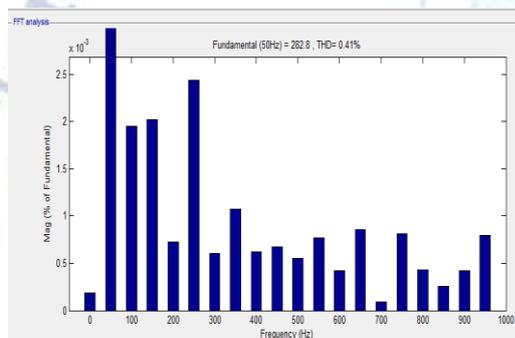


Figure 12: THD for Source voltage

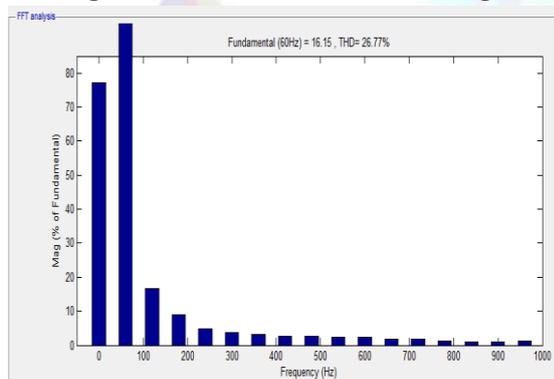


Figure 13: THD for Compensated voltage

## CONCLUSION

This paper proposed an ANN based seamless transfer controller between grid and islanding operations, with a stage secured circle controller a three-stage grid-associated Photovoltaic inverter. Both the present control for grid-associated operation and the voltage control for islanding operation were steady with positive stage edges. The synchronization point of the PLL expanded easily without sudden hops even under voltage

hangs and operation mode transfer. At the point when both the stage and extent of the heap voltage were at the same time changed in accordance with the grid voltage before transferring to the grid-associated operation, the output voltage and current had a few contortions toward the start of the synchronization process. At the point when the mode transitioned to the islanding operation mode, the heap voltage immediately drew closer its craved voltage without voltage spikes and surge streams by utilizing the proposed working succession for consistent transfer.

## REFERENCES

- [1] R. Datta and V. T. Ranganathan, "Variable-speed wind power generation using doubly fed wound rotor induction machine—A comparison with alternative schemes," *IEEE Trans. Energy Convers.*, vol. 17, no. 3, pp. 414–421, Sep. 2002.
- [2] J. Arbi, M. J.-B. Ghorbal, I. Slama-Belkhdja, and L. Charaabi, "Direct virtual torque control for doubly fed induction generator grid connection," *IEEE Trans. Ind. Appl.*, vol. 47, no. 1, pp. 4163–4173, Jan./Feb. 2011.
- [3] A. Luna, K. Lima, D. Santos, R. Paul, and S. Arnaltes, "Simplified modeling of a DFIG for transient studies in wind power applications," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 9–19, Jan 2011.
- [4] M. J. Hossain, H. P. Pota, V. A. Ugrinovskii, and R. A. Ramos, "Simultaneous STATCOM and pitch angle control for improved LVRT capability of fixed-speed wind turbines," *IEEE Trans. Sustainable Energy*, vol. 1, no. 3, pp. 142–151, Oct. 2010.
- [5] A. Causebrook, D. J. Atkinson, and A. G. Jack, "Fault ride-through of large wind farms using series dynamic braking resistors," *IEEE Trans. Power Syst.*, vol. 22, no. 3, pp. 966–975, Aug. 2007.
- [6] M. E. Haque, M. Negnevitsky, and K. M. Muttaqi, "A novel control strategy for a variable-speed wind turbine with a permanent-magnet synchronous generator," *IEEE Trans. Ind. Appl.*, vol. 46, no. 1, pp. 331–339, Jan./Feb 2010.
- [7] W. Qiao, L. Qu, and R. G. Harley, "Control of IPM synchronous generator for maximum wind power generation considering magnetic saturation," *IEEE Trans. Ind. Appl.*, vol. 45, no. 3, pp. 1095–1105, May/Jun. 2009.
- [8] C. S. Brune, R. Spee, and K. Wallace, "Experimental evaluation of a variable-speed doubly-fed wind-power generation system," *IEEE Trans. Ind. Appl.*, vol. 30, no. 3, pp. 648–655, May/Jun. 1994.
- [9] S. Bhowmik, R. Spee, and J. H. R. Enslin, "Performance optimization for doubly fed wind power generation systems," *IEEE Trans. Ind. Appl.*, vol. 35, no. 4, pp. 949–958, Jul/Aug. 1999
- [10] C.-H. Liu and Y.-Y. Hsu, "Effect of rotor excitation voltage on steady-state stability and maximum output power of a doubly fed induction generator," *IEEE Trans. Ind. Electron.*, vol. 58, no. 4, pp. 1096–1109, Apr. 2011.
- [11] A. Petersson and S. Lundberg, "Energy efficiency comparison of electrical systems for wind turbines," in *Proc. IEEE Nordic Workshop Power Ind. Electron. (NORPIE)*, Stockholm, Sweden, Aug. 2002, pp. 12–14.
- [12] A. C. Smith, R. Todd, M. Barnes, and P. J. Tavner, "Improved energy conversion for doubly fed wind generators," *IEEE Trans. Ind. Appl.*, vol. 42, no. 6, pp. 1421–1428, Nov./Dec. 2006.

- [13] S. Muller, M. Deicke, and R. W. De Doncker, "Doubly fed induction " generator systems for wind turbines," IEEE Ind. Appl. Mag., vol. 8, no. 3, pp. 26–33, May/Jun. 2002.
- [14] Mihai Ciobotaru-Macquarie University and F.Blaabjerg-Aalborg University, "Control of Single-Stage Single-Phase PV Inverter," Sep 2006, Epe journal 16(3):20-26, DOI:10.1080/0939368.2006.11463624, Source: IEEE Xplore.
- [15] Md.Apel Mahmud, M.J.Hossain, "Robust Nonlinear Distributed Controller Design for Active and Reactive Power Sharing in Islanded Micro grids," Dec 2014, IEEE Transactions on Energy Conversion 29(4):893-903.\Bo and Yang, "Power Management of Multi-level Renewable-Grid Integrated Hybrid Energy Harvesting System using Model Predictive Approach," 978-1-5386-9316-2/18/\$31.00 ©2018 IEEE.
- [16] Hung-I Hsieh-National Chiayi University and Guan Chyun Hsieh-Chung Yuan Christin University ,"A Study of High-Frequency Photovoltaic Pulse Charger for Lead-Acid Battery Guided by PI-INC MPPT," Nov 2012, DOI:10.1109/ICRERA.2012.6477422, Conference: Renewable Energy Research and Applications (ICRERA), 2012 International Conference.

